

AECOM

PROJECT

CULMULLIN 220 kV SUBSTATION

CLIENT

ENERGIA SOLAR HOLDINGS LTD.



CONSULTANT

AECOM
Adelphi Plaza
Georges Street Upper
Dun Laoghaire
County Dublin
Ireland
T +353 (0)1 2383100
www.aecom.com

LEGEND

PROPOSED DEVELOPMENT BOUNDARY

NOTES

ISSUE/REVISION

NO.	DATE	DESCRIPTION
1	27.03.23	REVISED REDLINE BOUNDARY
2	26.05.23	UPDATE BOUNDARY

STATUS

FOR PLANNING

PROJECT NUMBER SCALE




60657534 1:200 @ A1

SHEET TITLE

CULMULLIN 220 kV SUBSTATION
INDICATIVE VEHICLE TRACKING
Sheet 2 of 8

SHEET NUMBER REV

60657534-ACM-DWG-CM-521 2

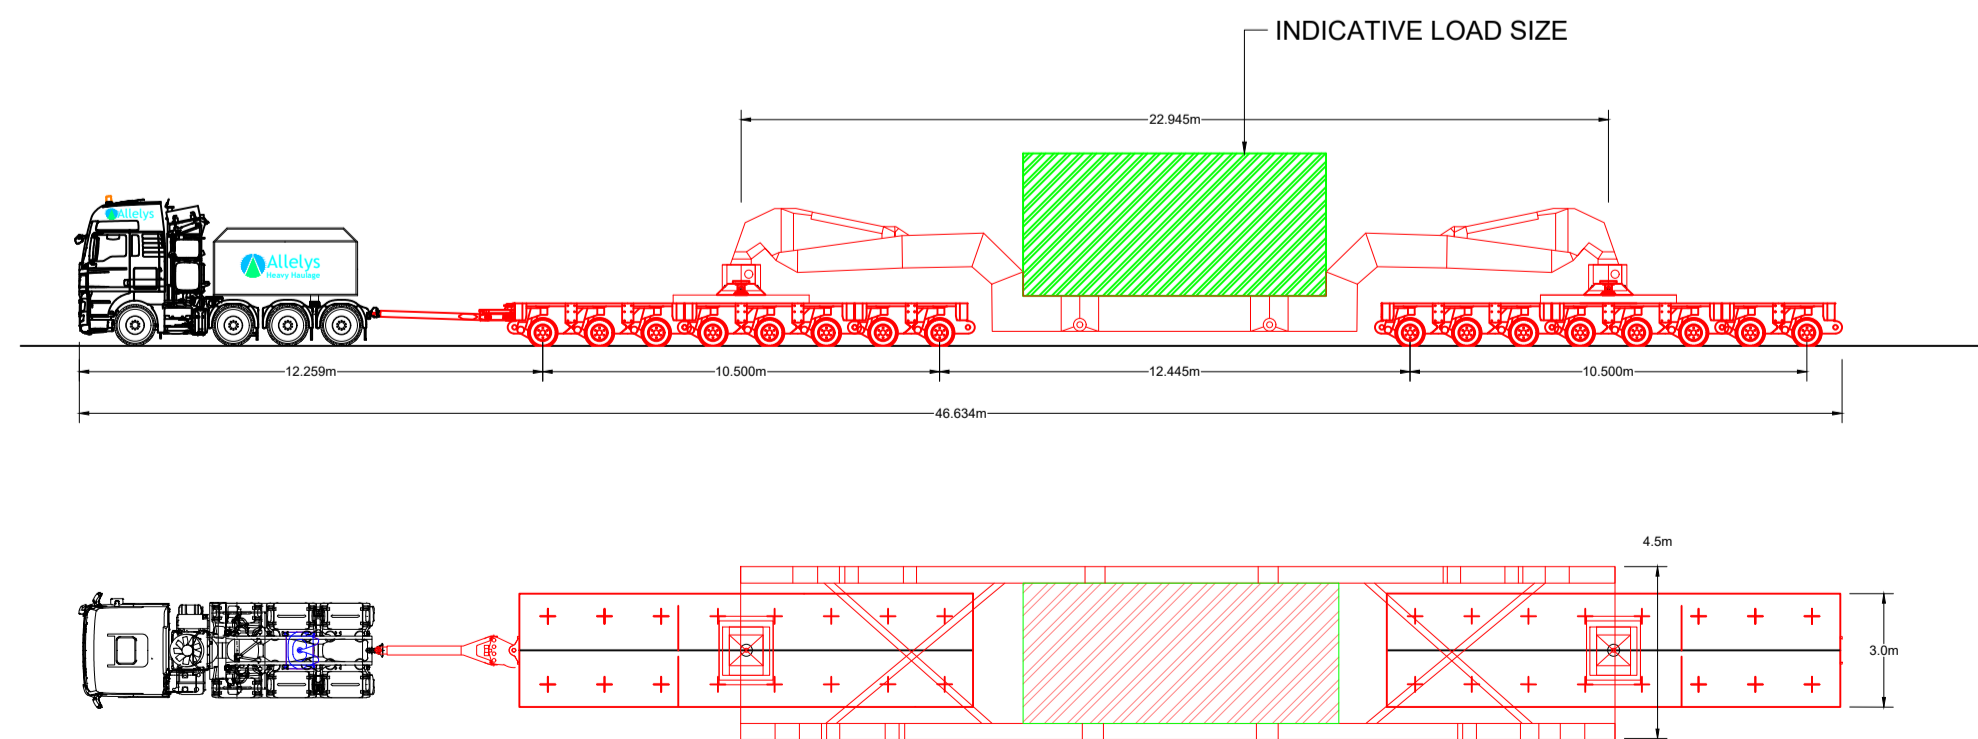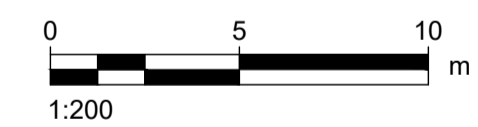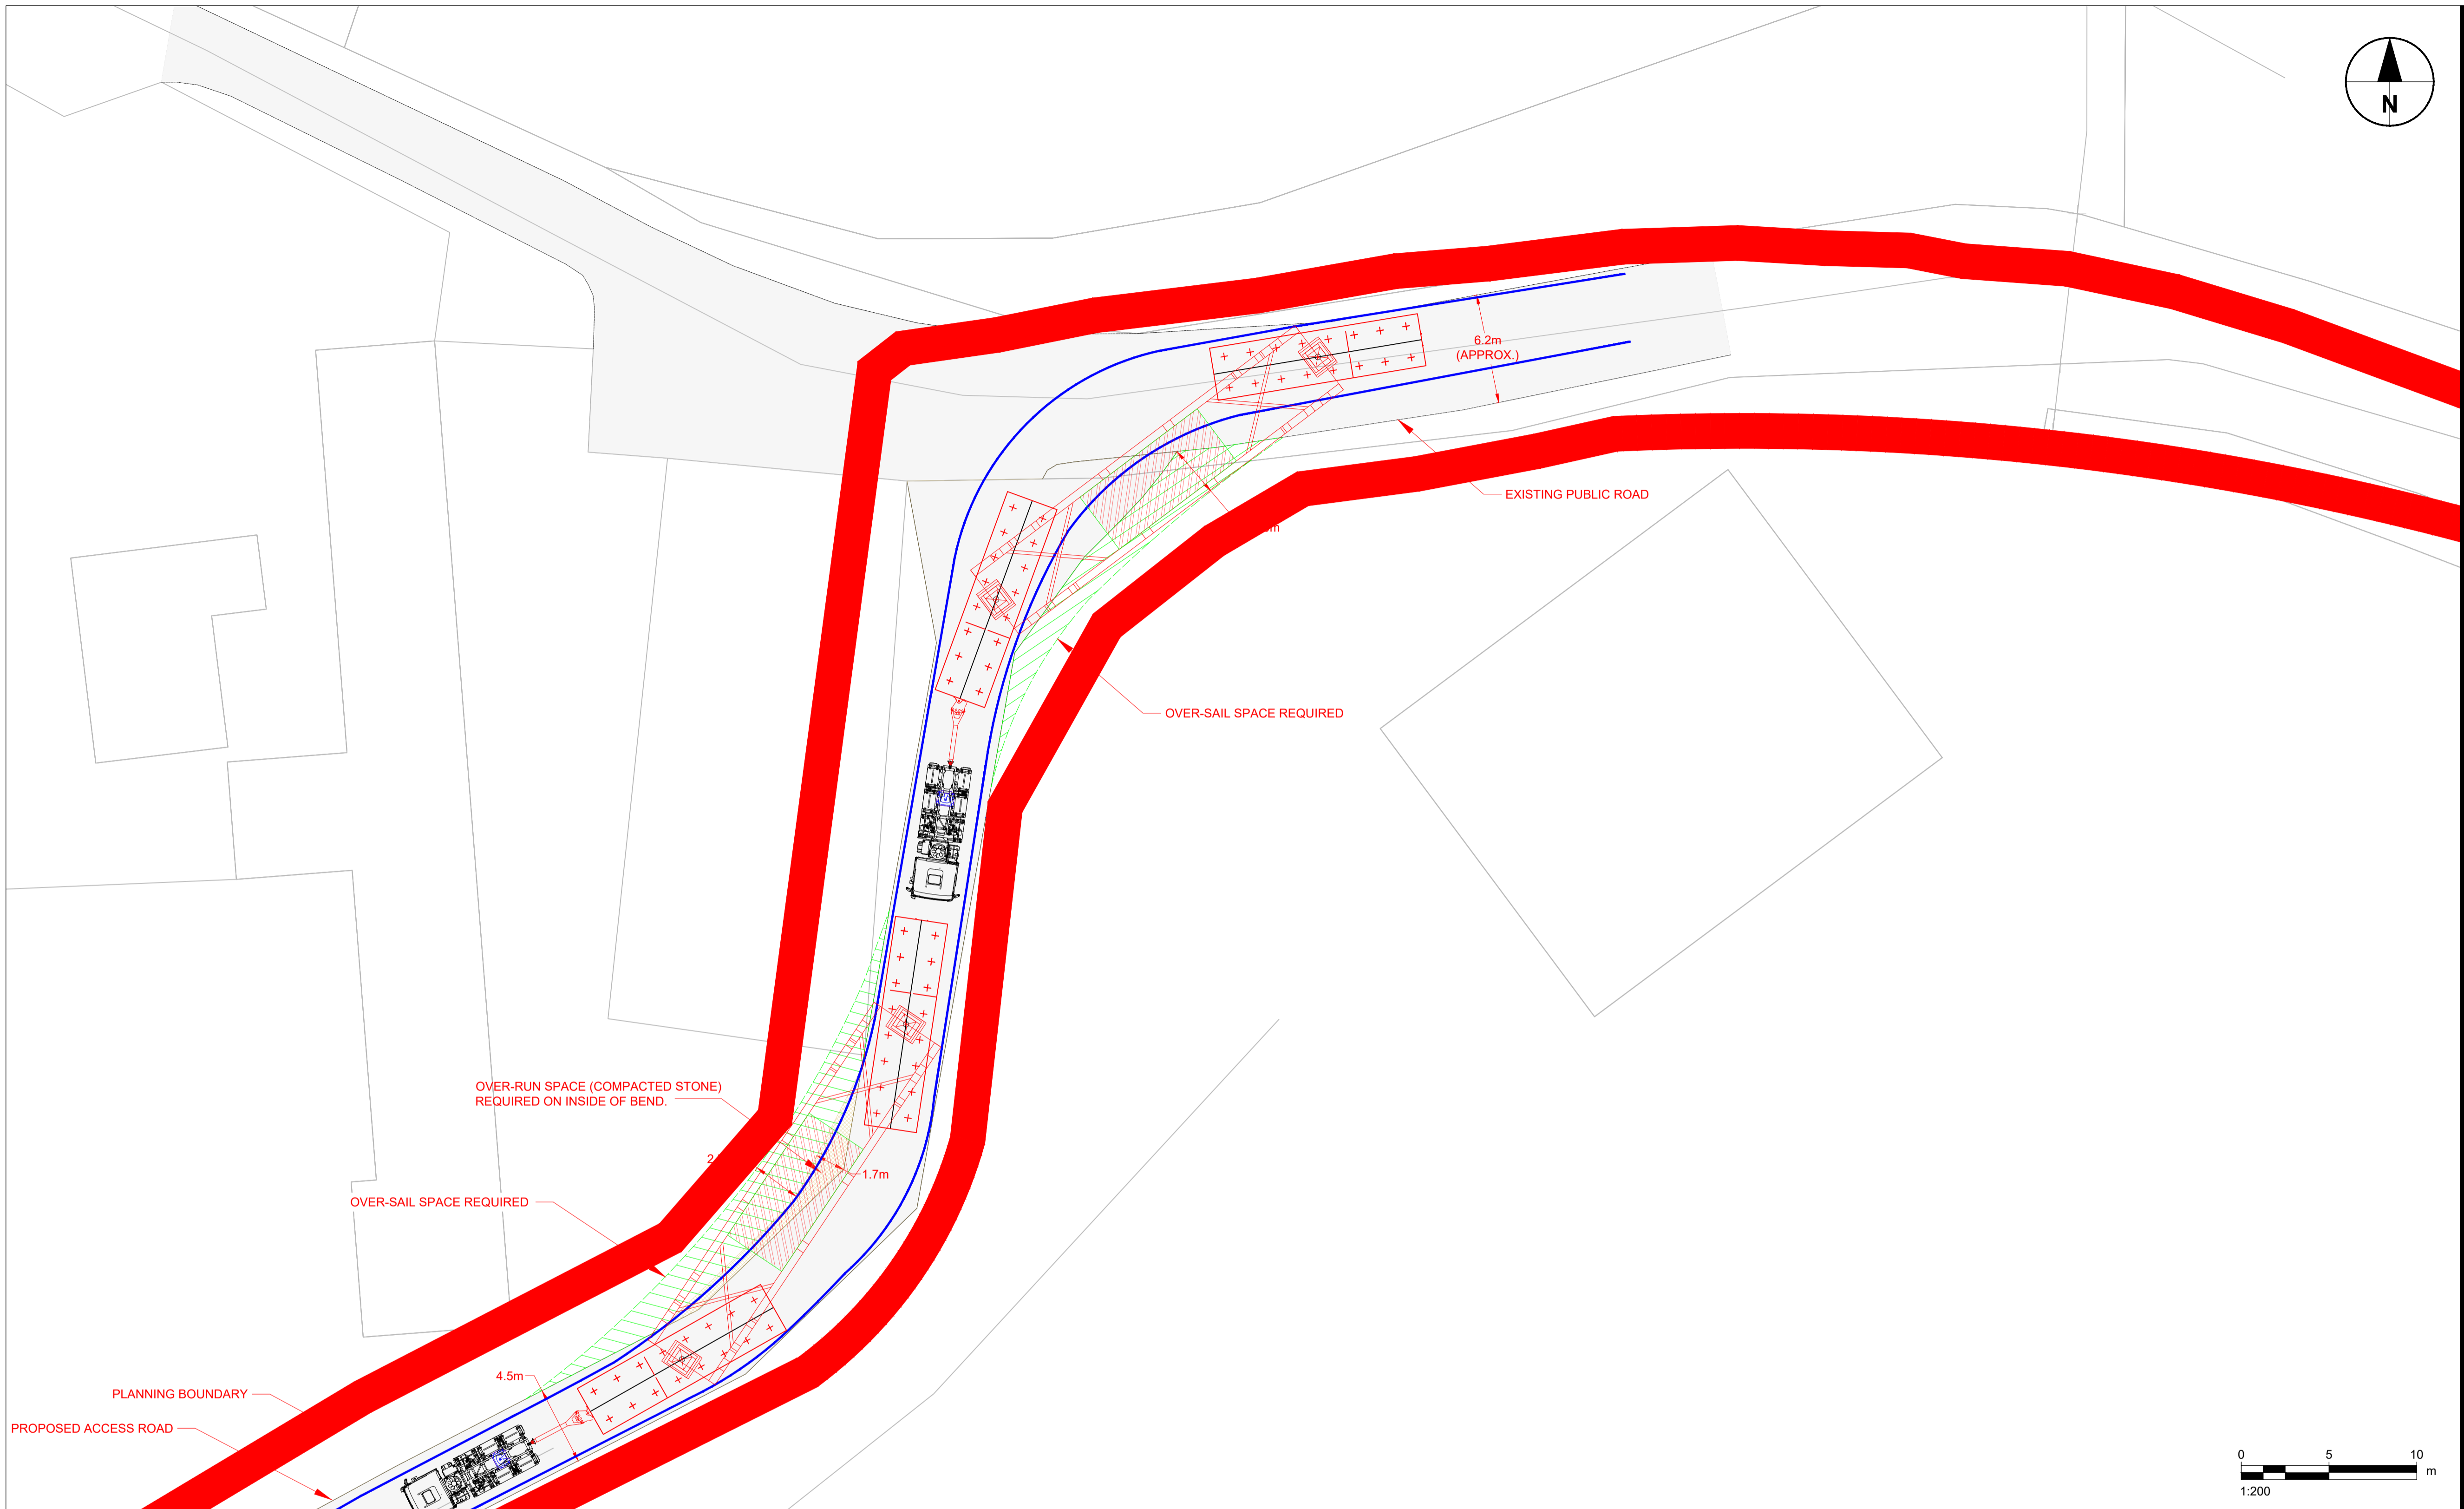

VEHICLE CONFIGURATION - 16-AXLE GIRDER TRAILER

1. VEHICLE TRACKING SHOWN IS INDICATIVE ONLY, AND REPRESENTS APPROXIMATE VEHICLE SIZE ANTICIPATED FOR TRANSFORMER DELIVERY. SPECIFIC VEHICLE TO BE DETERMINED BY EQUIPMENT SUPPLIER / HAULIER.
2. DEFINITIVE VEHICLE TRACKING OF SPECIFIC DELIVERY VEHICLE REQUIRES TO BE CARRIED OUT BY HAULIER, TO ENSURE DESIRED MANOEUVRES ARE ACHIEVABLE, AND TO CONFIRM ANY REQUIRED ROAD WIDENING, TEMPORARY WORKS, etc.

KEY:

- APPROXIMATE VEHICLE WHEEL TRACK
- OVER-RUN SPACE REQUIRED (COMPACTED STONE)
- OVER-SAIL SPACE REQUIRED

ORDNANCE SURVEY IRELAND LICENCE No. CYAL50217544
© ORDNANCE SURVEY IRELAND / GOVERNMENT OF IRELAND

This drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or relied upon by third parties, except as agreed by AECOM or as required by law. AECOM accepts no responsibility, and denies any liability, whatsoever, to any party that uses or relies on this drawing without AECOM's express written consent. Do not scale this document. All measurements must be obtained from the stated dimensions.

Approved PO
Checked EP
Designer DWT

PM Initials

Last saved by: BERNICE CAHILL (2023-06-21) Last Plotted: 2023-06-21
Filename: L:\DUBLIN\EDBLZ\LEGACY\IEDBLZ\PROJECTS\IPROJECTS\IPROJECTS\B\60657534_SUMMERHILL\FIELDSTOWNS\DI\900_CAD_GIS\910_CAD\CULMULLIN\PLANNING\FOLDER\60657534-ACM-DWG-520 TO 527.DWG